


# LEVEL/MICRO-SWITCH FOR CRYOGENIC/LIQUIFIED GAS APPLICATIONS

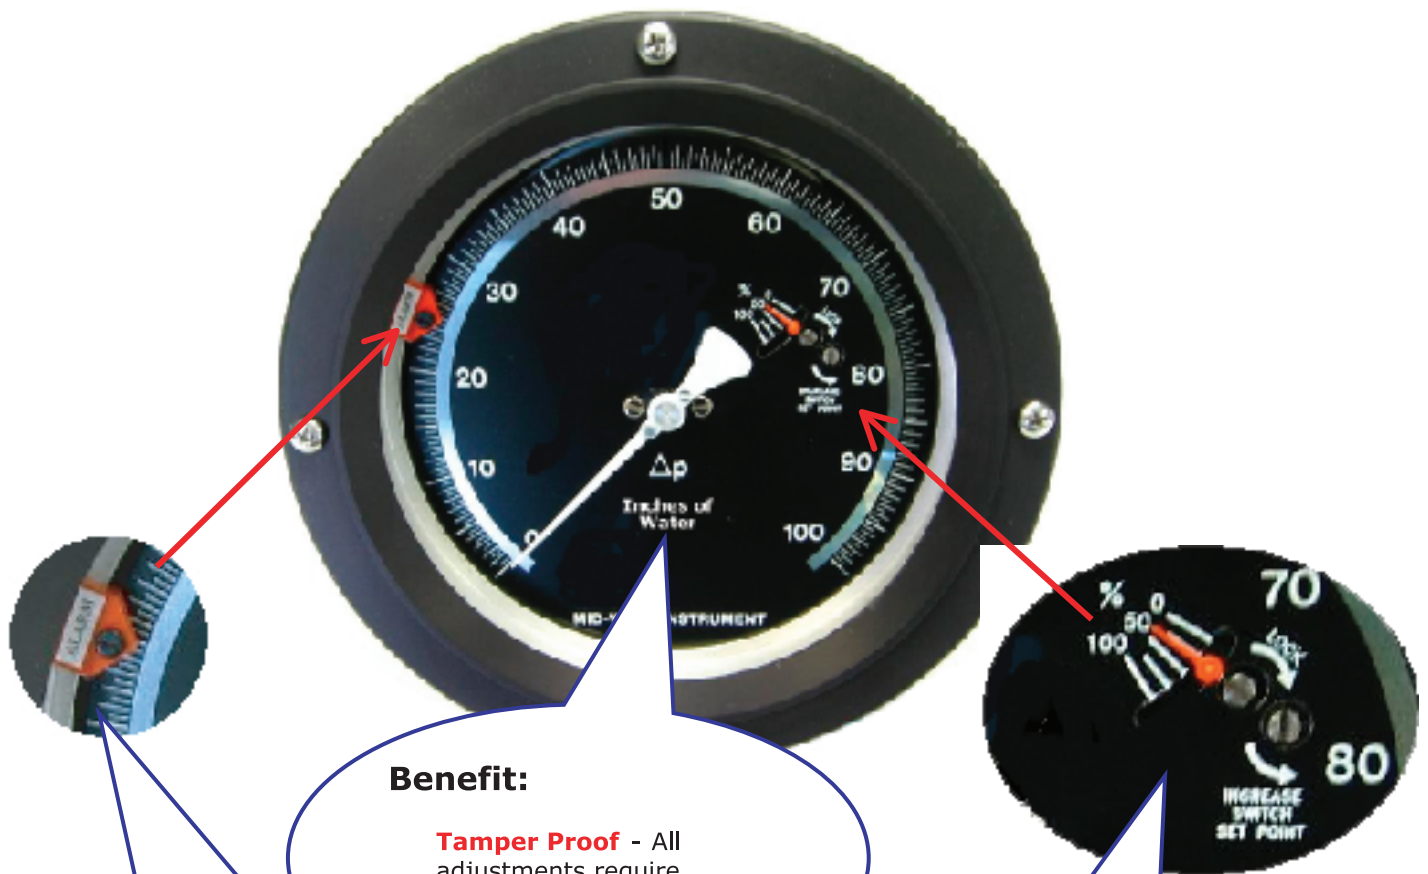

### Benefit:

**Tamper Proof** - All adjustments require removal of the bezel for access.

### Benefit:

**Switch Flag** - Can be precisely adjusted to switch set point for highly visible alarm indication.

### Benefit

1. **Switch Adjust** - Adjustable set point from 3% to 100 % of Full Scale on decreasing pressure.
2. **Switch Set Feedback** - Provides feedback of the approximate switch set point during adjustment of the switch.
3. **Switch Lock** - Locks Switch Set to prevent shift in set point due to vibration.

1. Remove Bezel



2. Unlock Switch Adjust

3. Adjust switch to approximate alarm point using the switch set feedback.

4. Using the appropriate equipment & pressure source, precisely set the switch using the dial indicator.



5. Once the switch is adjusted to the desired alarm point, tighten the lock screw.

6. Loosen the screw on the switch flag and adjust to the precise alarm point.



7. Lock Switch Flag to provide a Highly Visible Alarm Point Indication.



8. Replace the Bezel